


CR441EHO


ELECTRONIC HOLD OPEN

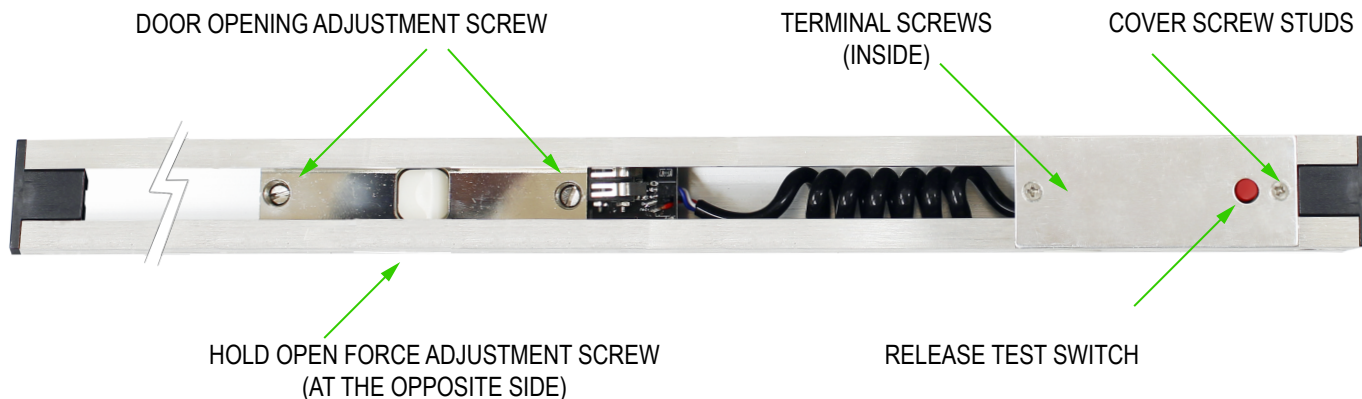


HOLD OPEN FORCE ADJUSTMENT:

Locate hold-open adjustment screw in diagram below.

For greater hold open force, turn screw a quarter of a turn each clockwise. Do the opposite for a lesser hold open force. Maximum of two full turns.

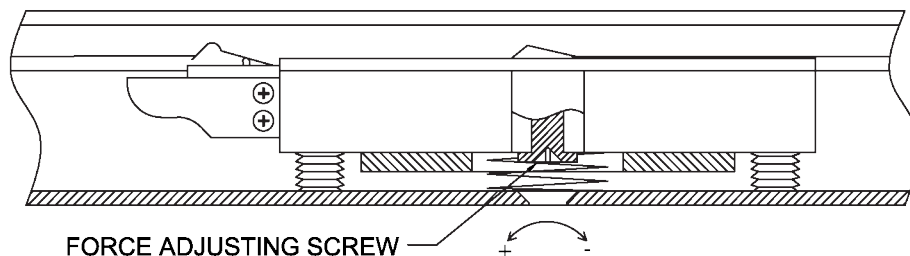

TERMINAL WIRING CONFIGURATION:

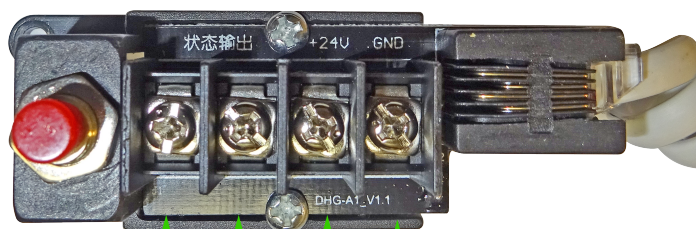

INPUT
MONITOR SWITCH

MONITOR SWITCH
Switch is Normally Closed when door is in close position
Switch is Normally Open when door is in hold open position